




TEE

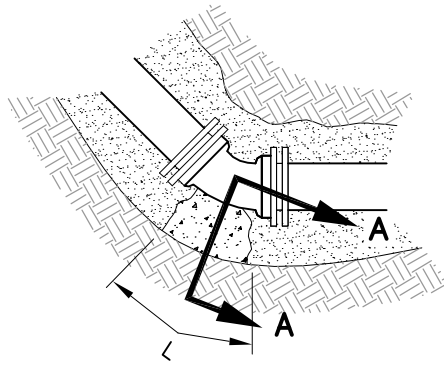


BEND < 90°

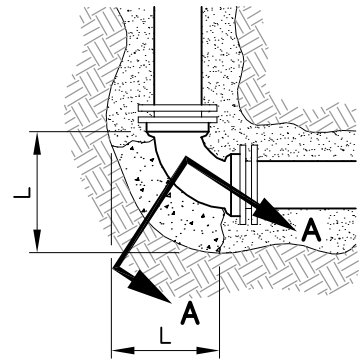


HORIZONTAL BEND




REDUCER

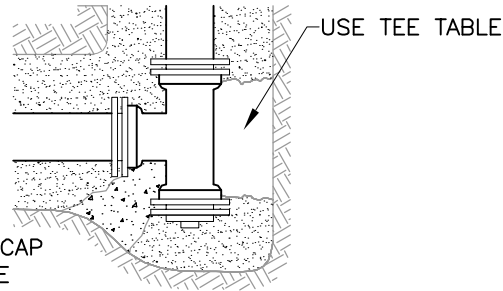


TEE W/ ONE PLUG END




SECTION A-A

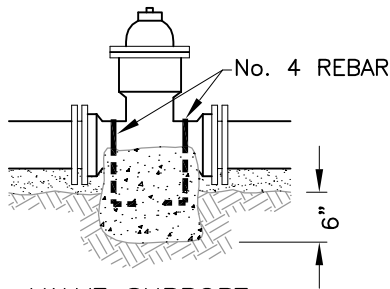

VALVE SUPPORT

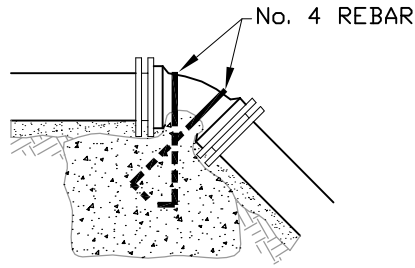


VERTICAL OVER BEND

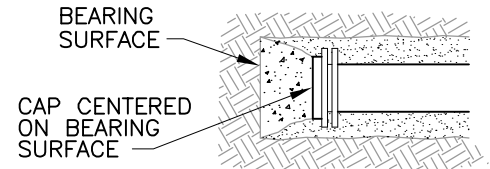

CAP

NOTES

1. CONCRETE SHALL NOT LAP ONTO BOLTS.
2. EMBED REINFORCING 12" MIN. INTO CONCRETE HOOK ENDS.
3. ALL FITTINGS TO BE POLYETHELENE WRAPPED

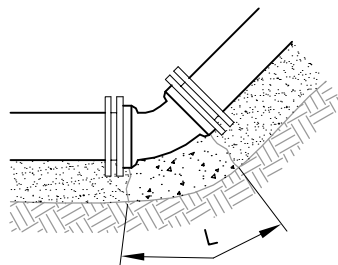

VERTICAL UNDER BEND

	UNDISTURBED GROUND
	CONCRETE THRUST BLOCK
	SUITABLE BEDDING MATERIAL